

# EASTMAN PERFORMANCE FILMS, LLC TEST REPORT

**SCOPE OF WORK**

ASTM E283, ASTM E331 AND ASTM E330/E330M TESTING  
ON R20 SR PS9 FILM, FIXED WINDOW

**REPORT NUMBER**

J3555.02-109-44

**TEST DATE**

06/18/19

**ISSUE DATE**

07/01/19

**RECORD RETENTION END DATE**

06/18/23

**PAGES**

13

**DOCUMENT CONTROL NUMBER**

ATI 00479 (07/24/17)

RT-R-AMER-Test-2805

© 2017 INTERTEK



## TEST REPORT FOR EASTMAN PERFORMANCE FILMS, LLC

Report No.: J3555.02-109-44

Date: 07/01/19

### REPORT ISSUED TO

#### EASTMAN PERFORMANCE FILMS, LLC

4210 The Great Road  
Fieldale, Virginia 24089

### SECTION 1

#### SCOPE

Intertek Building & Construction (B&C) was contracted by Eastman Performance Films, LLC to perform testing in accordance with ASTM E283, ASTM E331, and ASTM E330/E330M, on their R20 SR PS9 Film, fixed window. Results obtained are tested values and were secured by using the designated test method(s). Testing was conducted at Intertek B&C test facility in York, Pennsylvania.

This report does not constitute certification of this product nor an opinion or endorsement by this laboratory.

### SECTION 2

#### SUMMARY OF TEST RESULTS

TITLE	RESULTS
Design Pressure	±2400 Pa (±50.13 psf)
Air Infiltration 300 Pa (6.27 psf)	<0.1 L/s/m <sup>2</sup> (<0.01 cfm/ft <sup>2</sup> )
Air Exfiltration 300 Pa (6.27 psf)	<0.1 L/s/m <sup>2</sup> (<0.01 cfm/ft <sup>2</sup> )
Water Penetration Resistance	Failure
Uniform Load Structural Test Pressure	±3600 Pa (±75.19 psf)

For INTERTEK B&C:

<b>COMPLETED BY:</b>	John A. Shanabrook	<b>REVIEWED BY:</b>	Timothy J. McGill
<b>TITLE:</b>	Technician – Product Testing	<b>TITLE:</b>	Manager – Product Testing
<b>SIGNATURE:</b>		<b>SIGNATURE:</b>	
<b>DATE:</b>	07/01/19	<b>DATE:</b>	07/01/19

JAS:wnl

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample(s) tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.

## TEST REPORT FOR EASTMAN PERFORMANCE FILMS, LLC

Report No.: J3555.02-109-44

Date: 07/01/19

### SECTION 3

#### TEST METHOD(S)

The specimen was evaluated in accordance with the following:

**ASTM E283-04(2012)**, *Standard Test Method for Determining Rate of Air Leakage Through Exterior Windows, Curtain Walls, and Doors Under Specified Pressure Differences Across the Specimen*

**ASTM E330/E330M-14**, *Standard Test Method for Structural Performance of Exterior Windows, Doors, Skylights and Curtain Walls by Uniform Static Air Pressure Difference*

**ASTM E331-00(2016)**, *Standard Test Method for Water Penetration of Exterior Windows, Skylights, Doors, and Curtain Walls by Uniform Static Air Pressure Difference*

### SECTION 4

#### MATERIAL SOURCE/INSTALLATION

Test specimen was provided by the client. Representative samples of the test specimen will be retained by Intertek B&C for a minimum of four years from the test completion date.

The specimen was installed into a Spruce-Pine-Fir wood buck. The rough opening allowed for no shim space. The exterior perimeter of the window was sealed with duct tape.

LOCATION	ANCHOR DESCRIPTION	ANCHOR LOCATION
Head, sill, and jambs	1" x 1" wood blindstops at the interior of the specimen with #8 x 3" flat head screws	The anchors were located at the head, sill, and jambs. The screws were located 3" from each corner and spaced 8" on center.
	2x4 wood blindstops at the exterior of the specimen with #8 x 3" flat head screws	The anchors were located at the head, sill, and jambs. Two screws were located at each end of the head and sill blindstops and then one screw was spaced 8" on center. The jamb blindstops had one screw at each end and then spaced 8" on center.

Tape and film were not used to seal against air leakage during structural testing.

## TEST REPORT FOR EASTMAN PERFORMANCE FILMS, LLC

Report No.: J3555.02-109-44

Date: 07/01/19

### SECTION 5 EQUIPMENT

Tape Measure Verification: 63788  
Control Panel: 005644  
Weather Station: 63316  
Spray Rack: 003956D  
Linear Transducers: INT00142, INT00141, INT00153

### SECTION 6 LIST OF OFFICIAL OBSERVERS

NAME	COMPANY
Steve DeBusk	Eastman Performance Films, LLC
Andrew P. Mehalick	Intertek B&C
Timothy J. McGill	Intertek B&C
John A. Shanabrook	Intertek B&C

### SECTION 7 TEST SPECIMEN DESCRIPTION

**Product Type:** Fixed Window

**Series/Model:** R20 SR PS9

OVERALL AREA:	WIDTH		HEIGHT	
	millimeters	inches	millimeters	inches
2.2 m <sup>2</sup> (24.0 ft <sup>2</sup> )				
Overall size	1219	48	1829	72

#### Frame Construction:

FRAME MEMBER	MATERIAL	DESCRIPTION
Head, sill, and jambs	Aluminum	Extruded, thermally improved, poured and debridged

	JOINERY TYPE	DETAIL
All corners	Butted	The corners were secured together using two #12 x 1" pan head screws through the head and sill and into the jamb screw bosses. Silicone was used to seal the gap at the glazing pocket.

## TEST REPORT FOR EASTMAN PERFORMANCE FILMS, LLC

Report No.: J3555.02-109-44

Date: 07/01/19

**Reinforcement:** No reinforcement was utilized.

**Weatherstripping:** No weatherstripping was utilized.

**Glazing:** *No conclusions of any kind regarding the adequacy or inadequacy of the glass in any glazed test specimen(s) can be made.*

GLASS TYPE	SPACER TYPE	INTERIOR LITE	EXTERIOR LITE	GLAZING METHOD
1" IG	Desiccant-filled aluminum spacer	1/4" clear annealed glass with a 0.009" laminate layer on the interior	1/4" clear annealed glass	Exterior glazed against a bead of Dow Corning 995 structural silicone and secured in place using a snap-in aluminum glazing bead at the sill with a rubber glazing strip against the glazing. A rubber glazing wedge was used at the exterior of the head, sill, and jambs.

LOCATION	QUANTITY	DAYLIGHT OPENING		GLASS BITE
		millimeters	inches	
Fixed daylight opening	1	1080 x 1695	42-1/2 x 66-3/4	3/8"

**Drainage:** No drainage was utilized.

**Hardware:** No hardware was utilized.

**TEST REPORT FOR EASTMAN PERFORMANCE FILMS, LLC**

Report No.: J3555.02-109-44

Date: 07/01/19

**SECTION 8  
TEST RESULTS**

The temperature during testing was 27°C (80°F - 81°F). The results are tabulated as follows:

TITLE OF TEST	RESULTS	ALLOWED	NOTE
<b>Air Leakage,</b> Infiltration per ASTM E283 at 300 Pa (6.27 psf)	<0.1 L/s/m <sup>2</sup> (<0.01 cfm/ft <sup>2</sup> )	Report Only	1
<b>Air Leakage,</b> Exfiltration per ASTM E283 at 300 Pa (6.27 psf)	<0.1 L/s/m <sup>2</sup> (<0.01 cfm/ft <sup>2</sup> )	Report Only	1
<b>Water Penetration,</b> per ASTM E331 at 140 Pa (2.92 psf)	Failure	No leakage	2
<b>Uniform Load Deflection,</b> per ASTM E330 Deflections taken at midspan of jamb +2400 Pa (+50.13 psf) -2400 Pa (-50.13 psf)	1.8 mm (0.07") 2.3 mm (0.09")	Report Only	3, 4
<b>Uniform Load Structural,</b> per ASTM E330 Permanent set taken at midspan of jamb +3600 Pa (+75.19 psf) -3600 Pa (-75.19 psf)	0.3 mm (0.01") 0.3 mm (0.01")	Report Only	3, 4

**General Note:** All testing was performed in accordance with the referenced standard(s).

Note 1: Test Date 06/18/19 / Time: 12:15 PM (Air Note Only)

Note 2: Water leakage through sill and jamb joinery 11 minutes into test.

Note 3: Loads were held for 10 seconds.

Note 4: Tape and film were not used to seal against air leakage during structural testing.

## TEST REPORT FOR EASTMAN PERFORMANCE FILMS, LLC


Report No.: J3555.02-109-44

Date: 07/01/19

### SECTION 9

#### LOCATION OF AIR SEAL

The air seal between the test specimen and the test wall is detailed below. The seal is made of foam weatherstripping and is attached to the edge of the test specimen buck. The test specimen buck is placed against the test wall and clamped in place, compressing the weatherstripping and creating a seal.

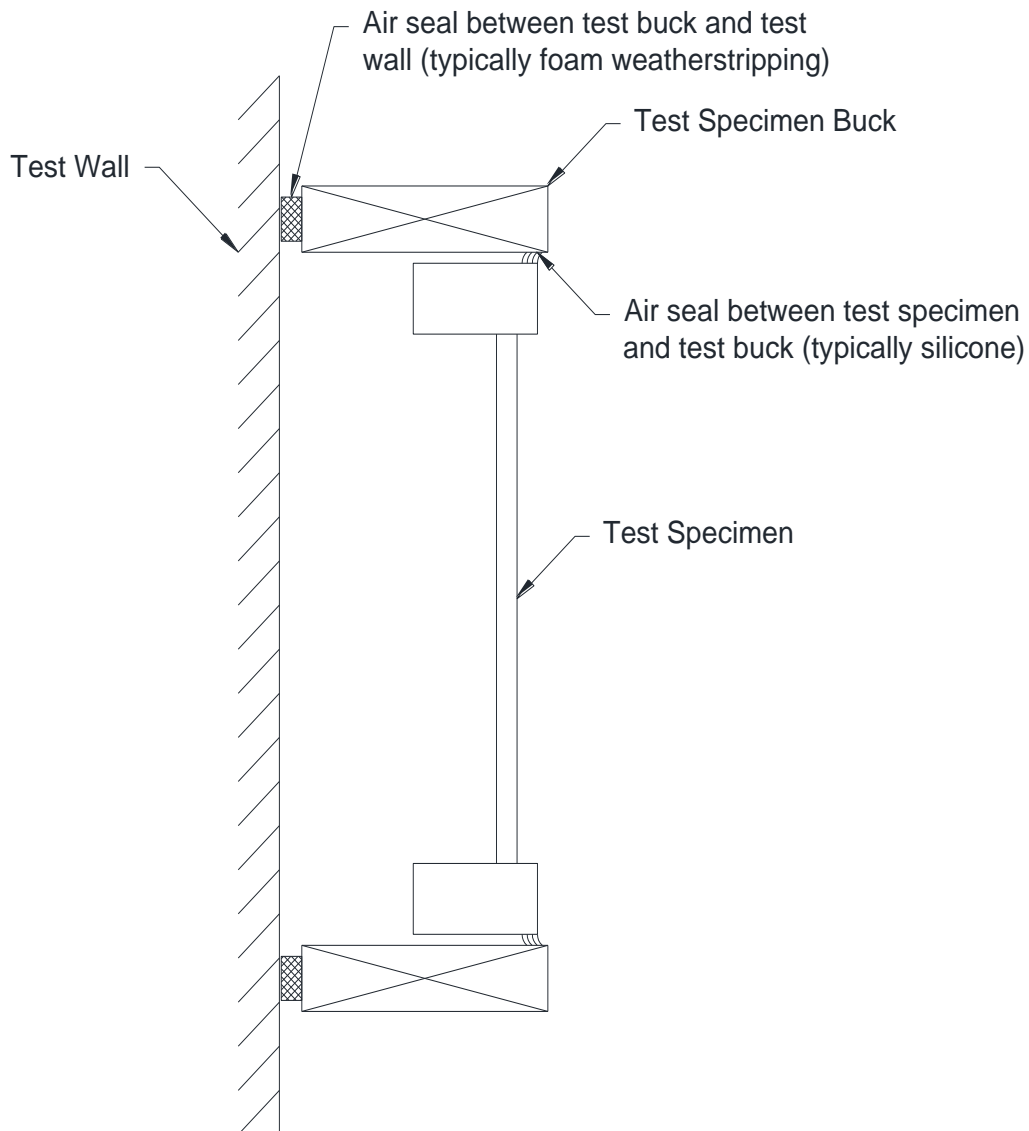

## TEST REPORT FOR EASTMAN PERFORMANCE FILMS, LLC

Report No.: J3555.02-109-44

Date: 07/01/19

### SECTION 10 PHOTOGRAPH



**Photo No. 1**  
**Specimen Prior to Testing**





Total Quality. Assured.

130 Derry Court  
York, Pennsylvania 17406

Telephone: 717-764-7700  
Facsimile: 717-764-4129  
[www.intertek.com/building](http://www.intertek.com/building)

## TEST REPORT FOR EASTMAN PERFORMANCE FILMS, LLC

Report No.: J3555.02-109-44


Date: 07/01/19


### SECTION 11 DRAWINGS

The test specimen drawings have been reviewed by Intertek B&C and are representative of the test specimen reported herein. Test specimen construction was verified by Intertek B&C per the drawings included in this report. Any deviations are documented herein or on the drawings.


Eastman Performance Films, LLC  
Intertek Quote 210800R0 Windstorm Testing  
Test Sample Details

**Kawneer 450 Aluminum Framing**

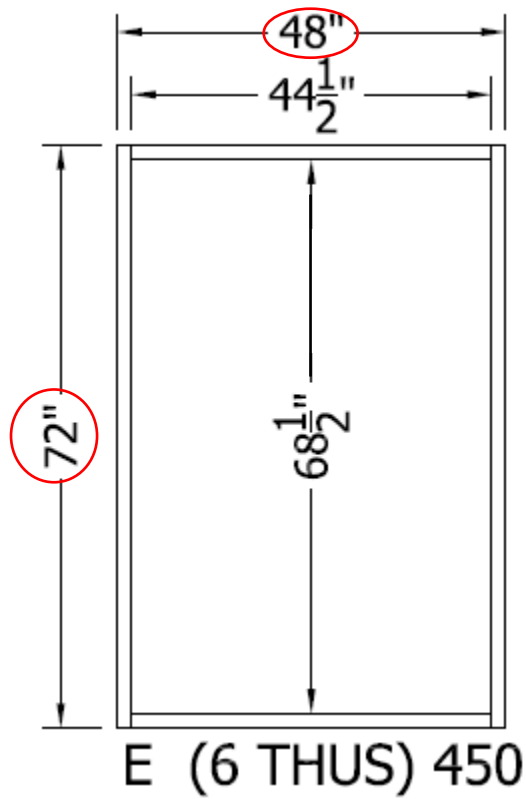

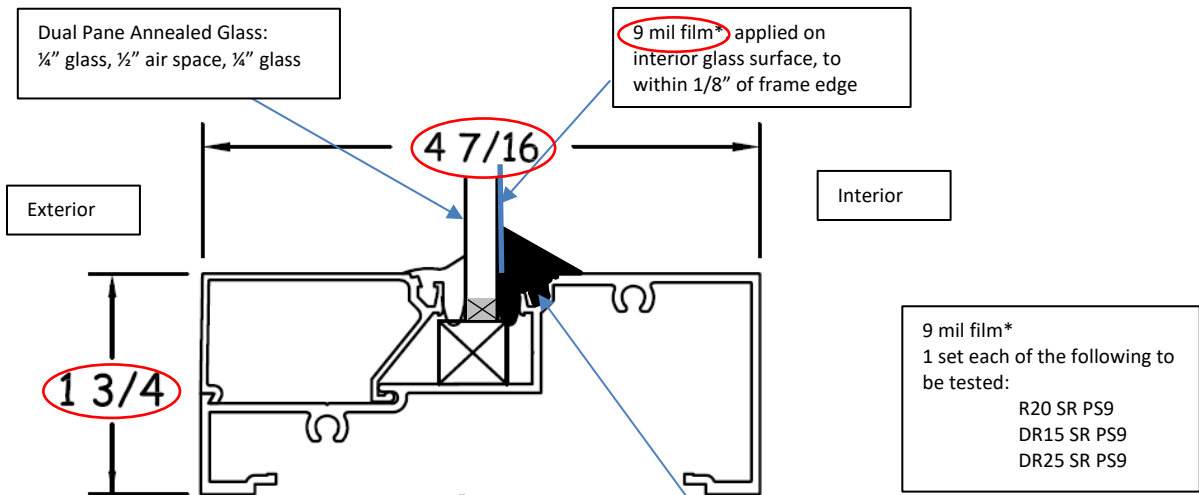


SILL  
 DETAIL F9

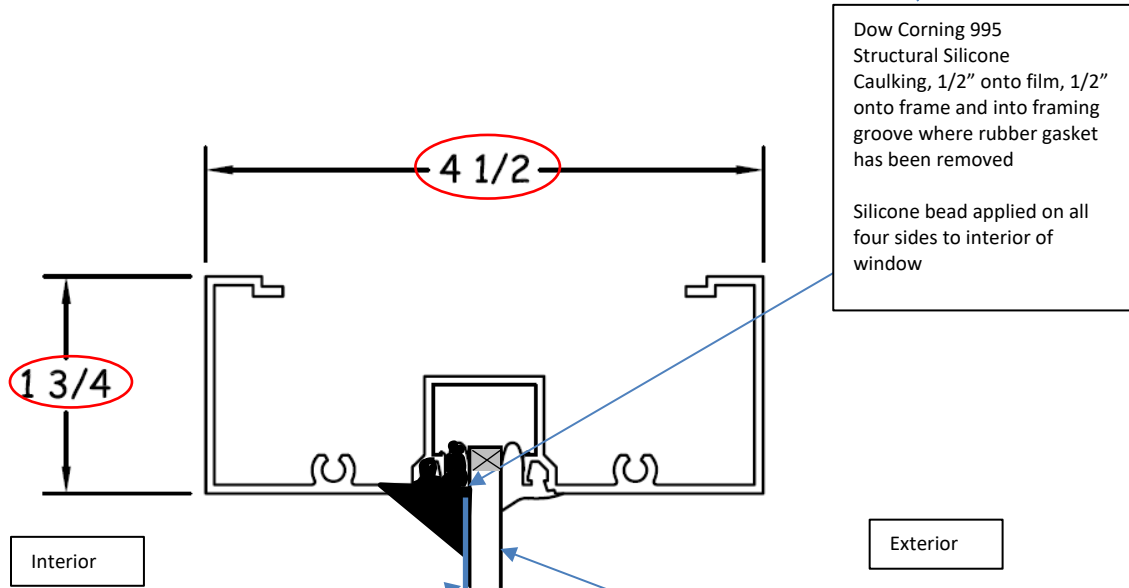

HEAD  
 DETAIL F12

9 mil film\*, applied on interior glass surface, to within  $\frac{1}{8}$ " of frame edge

Dual Pane Annealed Glass

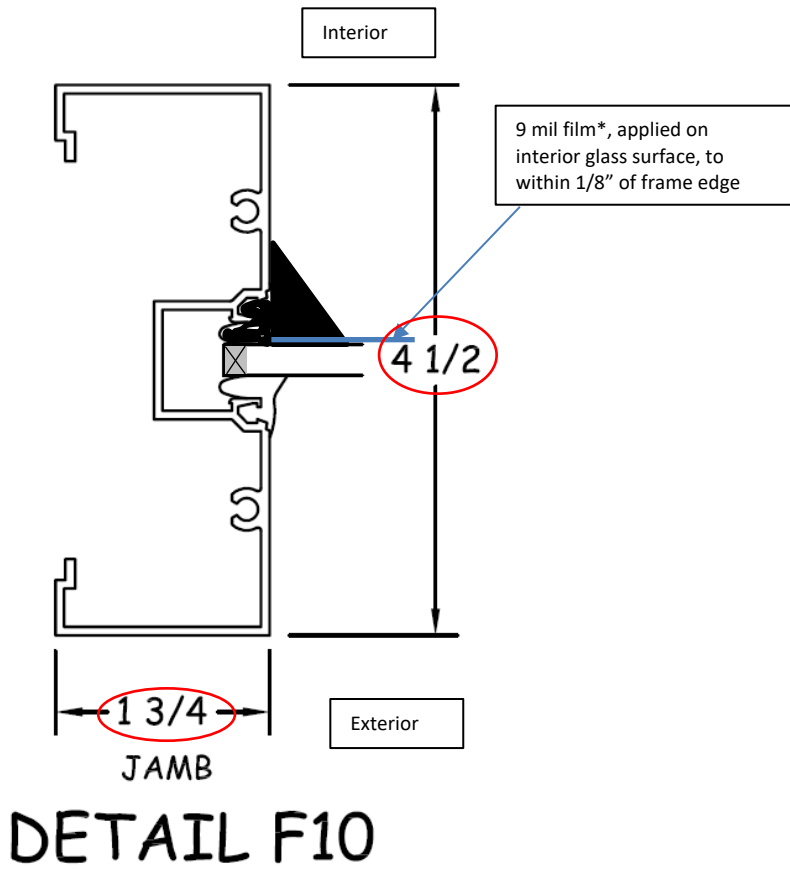



Total Quality. Assured.

130 Derry Court  
York, Pennsylvania 17406

Telephone: 717-764-7700  
Facsimile: 717-764-4129  
[www.intertek.com/building](http://www.intertek.com/building)

**TEST REPORT FOR EASTMAN PERFORMANCE FILMS, LLC**

Report No.: J3555.02-109-44

Date: 07/01/19

**SECTION 12**

**REVISION LOG**

REVISION #	DATE	PAGES	REVISION
0	07/01/19	N/A	Original Report Issue